


Profiles:

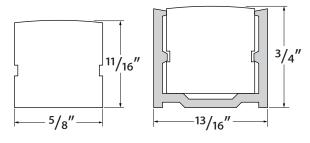

TRACE™ Vertical

TRACE™ is an indoor/outdoor low voltage lighting system used primarily for direct or indirect lighting designs.

Please verify the contents of the packages!

Please read instructions entirely before starting installation

Be sure power is turned off before installing the system Call Tivoli, LLC tech support with questions

Caution: TRACE[™] is designed to work with listed Class 2 24V DC transformers only. Use of any other power source will cause damage, shorten the life of the fixture and will void the warranty.

Consult any and all applicable local and national codes for installation.

Do not conceal or extend exposed conductors through a building wall as per local electrical code.

Warning: With any luminaire for any application, basic safety precautions should always be followed to reduce the risk of fire, electric shock and personal injuries. This lighting system should be installed by a certified professional.








WARNINGS

TRACE™ MAY BE EASILY DAMAGED! The reliability of the product can only be ensured if these warnings and cautions are complied with faithfully. Keep these instructions for future maintenance work.

WARNING! Risk of product damage.

Longer runs of Trace™ lighting strands must be installed by at least two people.

IMPORTANT! The Trace[™] luminaire must not be allowed to bend or hang down. That way, the bending limit will not be inadvertently exceeded, resulting in product damage.



Keep Trace™ from twisting or bending in the wrong direction.


Two person installation.

Warning! Risk of product damage.

Trace™ Vertical must not be bent at less than 3.5″ diameter or damage will result. Do not allow Trace™ to twist or bend in the wrong direction.


WARNING! Risk of Damage.

Insert Trace™ Vertical into channel evenly and gradually to keep twisting and bending to a minimum.

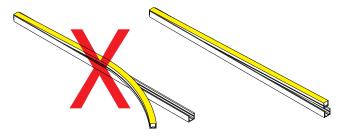

TRACE™ VERTICAL

Do not allow to twist or bend in the wrong direction.

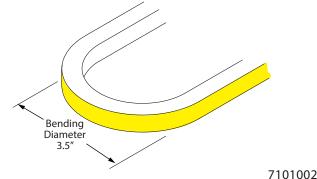




Overview: Read Before Installing Luminaire

Installation Notes:

Step 1: Measure run area where Trace™ is to be installed. Locate power feed end at highest point of the run to minimize exposure to water run off.

Step 2: A Mounting Channel is recommended for outdoor applications. Lay channel along desired area and attach with screws (by others) every 18 to 24 inches. If the design requires creating bends and arcs, it is recommended that the Vertical Notched Channels are used.

Note: Minimum bending diameter for the notched channel is 11". Trace $^{\text{m}}$ lighting strand must not be bent at less than 3.5" diameter or damage will result.



Warning: Risk of Product damage.


Do not stretch, pull, or yank. Doing so can damage the TraceTM internal connections and void the warranty.


Note: We recommend using a dry spray lubricant, such as 3M Spray Lubricant or WD-40 Specialist for all Trace™ installations to insure the luminaire fits into the channel without damage. Additionally, Silicone Sealant (**FLXD-SIL-GE-10**) must be applied to the inside bottom surface.

Step 4: Insert Trace[™] into mounted channel starting from power connector end. The End Cap and Power Feed Connector do not fit within the channel, so cut the Mounting Channel so that connectors and End Caps will overhang outside the ends of the Channel. Trace[™] should be pressed into the channel carefully and gradually, without excessive bending or damage will result.

Step 5: Secure power connection to building with use of C-clamp (by others) or mount connection inside J-Box.

Connect to 24V DC power supply according to supplied wiring diagrams.

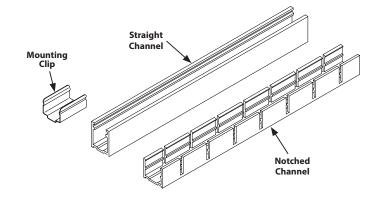

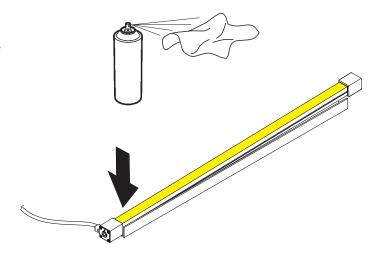



Trace™ Mounting Options

Trace™ Vertical with Mounting Clips

Warning: Risk of Product Damage.

Only bend the Trace $^{\mathsf{TM}}$ Vertical so the lens bends up or down. See diagram below.

Note: Minimum bending diameter for Trace[™] Vertical is 3.5" in the vertical direction only.

Step 1: Determine where the Mounting Clips will need to be installed to achieve the desired shape.

Step 2: Position the Mounting Clips and attach with screws (Included).

Step 3: Lay a bead of Silicone Adhesive (**FLXD-SIL-GE-10**) to the inside bottom surfaces of the Mounting Clips, as shown.

Step 4: Spray Dry Lubricant on a rag and wipe the inside upper surfaces of the mounting clips, as shown, to allow the Trace™ fixture to slide more easily into the mounting clip. 3M Spray Lubricant or WD-40 Specialist is recommended.



Regular WD40 490002 will stress craze, crack or swell the Trace™ Silicone covering. Do not use!

Step 5: Trace™ must be installed with two people. One to press the luminaire into the channel and the other to hold the spool and unroll it while keeping the Trace™ flex body straight.


Step 6: Press the Trace[™] into the Mounting Clips.


Step 7: Connect to power.

Bending Limitations

Warning! Risk of Product Damage.

Trace[™] Vertical can only be bent in the direction that does not twist the Tape Light.

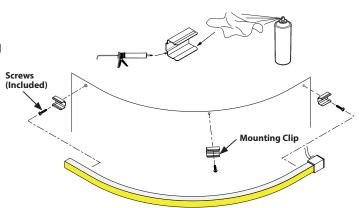

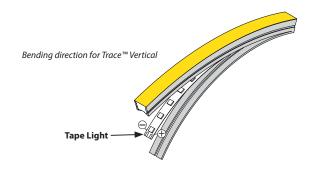



Trace Mounting Options (Continued)

Install Trace™ Vertical in Notched Mounting Channel

Warning: Risk of Product Damage.

Only bend the Trace™ Vertical so the lens bends up or down so as not to twist the Tape Light. See diagrams.

Note: Minimum bending diameter for the notched channel is 11". However, the minimum bending diameter for Trace Vertical is 3.5" in the vertical direction only.

Step 1: Determine Channel mounting Location.

Step 2: Drill a hole 3" from each end of the Channel and 18"-24" along length of Channel.

Step 3: Position the Notched Channel and attach with screws (by others).

Step 4: Lay a bead of Silicone Adhesive (**FLXD-SIL-GE-10**) to the inside bottom surfaces of the Notched Mounting channel, as shown.

Step 5: Spray dry lubricant on a rag and wipe along the inside upper surfaces of the extrusion. We recommend using a dry spray lubricant, such as 3M Spray Lubricant or WD-40 Specialist for all Trace installations to insure the luminaire fits into the channel without damage.

Step 6: Trace[™] must be installed with two people. One to press the luminaire into the channel and the other to hold the spool and unroll it while keeping the Trace[™] flex body straight.

Step 7: Start by orienting the Trace[™] with the Lens facing away from the Channel, as shown.

Step 8: Insert the Trace[™] body into the Channel one flex section at a time. Start at one end and and press it down carefully and gradually, working along the Channel, inserting the Trace[™] body into each section until the entire Trace[™] fixture is securely mounted in the channel.

WARNING! Risk of Product Damage.


Do not hammer or pound the luminaire into the channel. Once inserted, do not pull or yank on the fixture. Trace $^{\text{TM}}$ will be damaged unless it is handled carefully.


Step 9: Connect to power.

Bending Limitations

Warning! Risk of Product Damage.

Trace[™] Vertical can only be bent in the direction that does not twist the Tape Light.



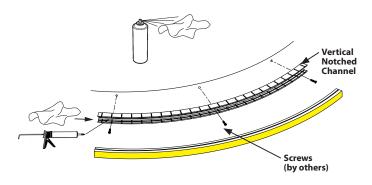





Trace™ Mounting Options (Continued)

Straight Channel for Trace™ Vertical Installation

Step 1: Prepare Straight Mounting Channel for installation cutting it to the correct length, keeping in mind that the End Caps will not fit inside the Channel, and by drilling screw holes 3" from each end and additional holes approximately every 18" along the channel.

Step 2: Place Straight Channel on the mounting surface and mark the hole locations.

Step 3: Remove the Channel and drill pilot holes at all hole locations.

Step 4: Place the Channel into position and secure with screws (not included).

Note: Screws (by others) should be appropriate for the mounting location. (ie: wood screws for wood, etc.)

Step 4: Lay a bead of Silicone Adhesive (**FLXD-SIL-GE-10**)) to the inside bottom surfaces of the Straight channel, as shown.

Step 5: Spray dry lubricant on a rag and wipe along the inside upper surfaces of the extrusion. We recommend using a dry spray lubricant, such as 3M Spray Lubricant or WD-40 Specialist for all TraceTM installations to insure the luminaire fits into the channel without damage.

Step 6: Trace™ must be installed with two people. One to press the luminaire into the channel and the other to hold the spool and unroll it while keeping the Trace™ flex body straight.

Step 7: Start by orienting the Trace[™] with the Lens facing away from the Channel, as shown.

Step8: IMPORTANT! Insert the Trace[™] body into the Channel. Start at one end and press it down carefully and gradually, working along the Channel, inserting the Trace[™] body along the channel until the entire Trace[™] fixture is securely mounted in the channel.

WARNING! Risk of Product Damage.


Do not hammer or pound the luminaire into the channel. Once inserted, do not pull or yank on the fixture. Trace™ will be damaged unless it is handled carefully.


Step 9: Connect to power.


Bending Limitations


Warning! Risk of Product Damage.

Trace™ Vertical can only be bent in the direction that does not twist the Tape Light.



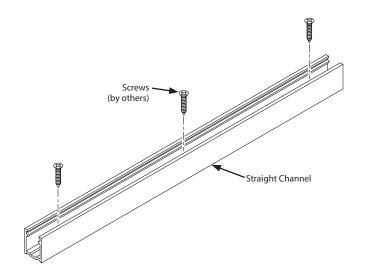

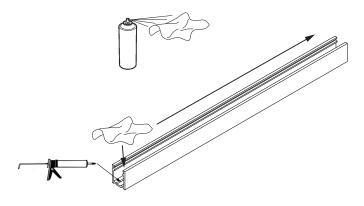


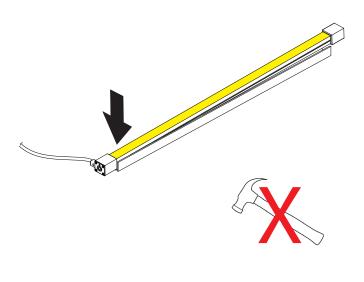


7101002



Trace™ Mounting Options (Continued)



Note: Trace $^{\text{\tiny{M}}}$ Mounting Channel can be mounted on horizontal or vertical surfaces.



LUMINAIRE	MAX CONTINUOUS RUN LENGTH		
Trace™	Low Output	Standard	High
Horizontal and Vertical	58′	29′	19′



Power Supply with 0-10V Sample Wiring Diagram

There are many possible options for dimming Trace™. See the specification Sheet for more information. The following wiring diagram is for reference only. Please refer to the Installation Instruction for the Power Supply you choose for detailed wiring instructions.

